
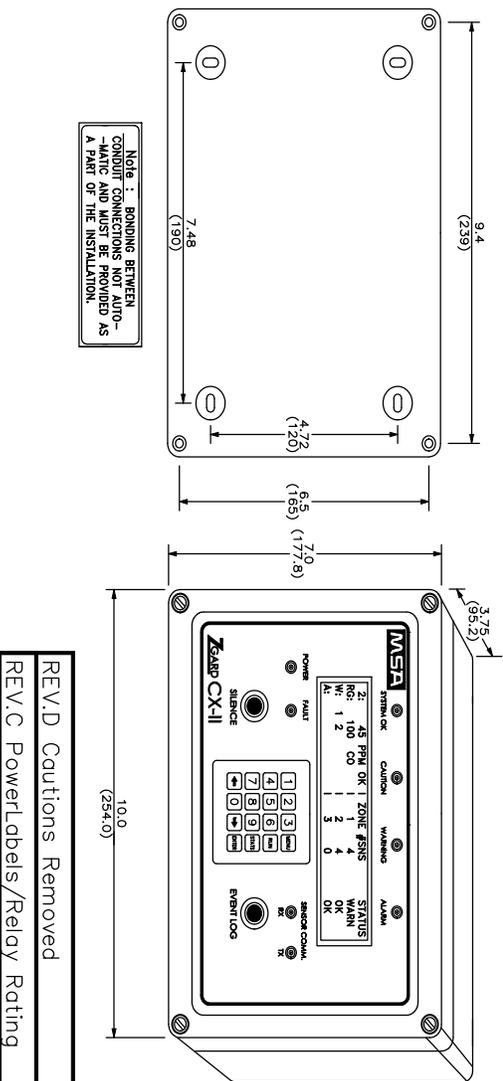
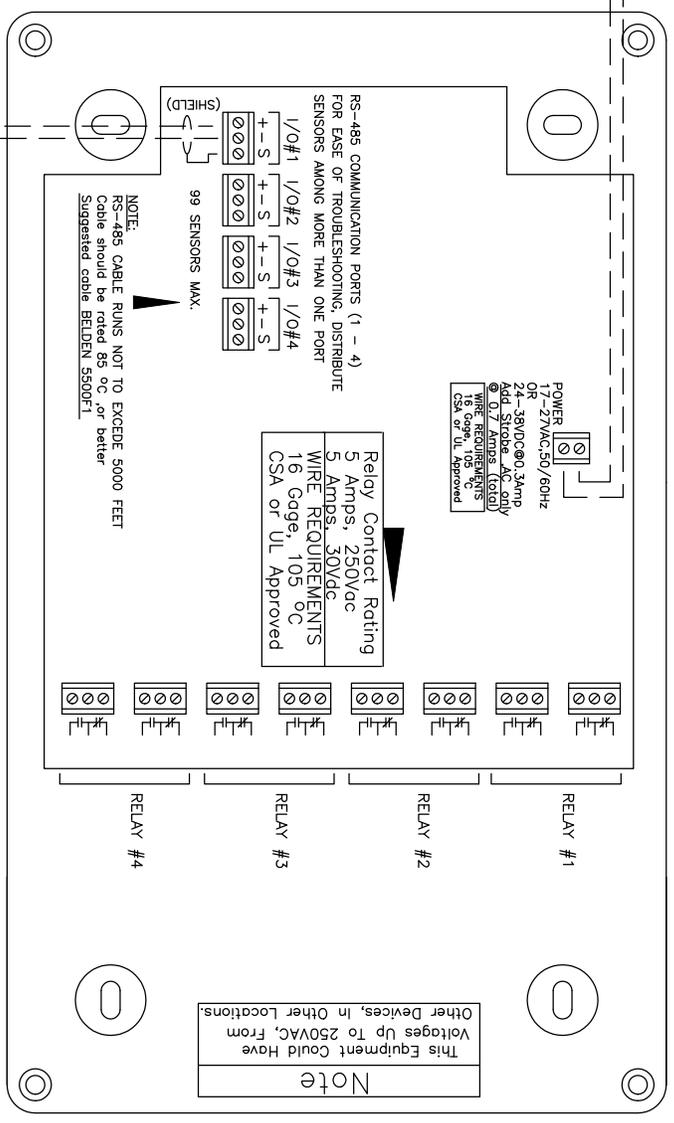
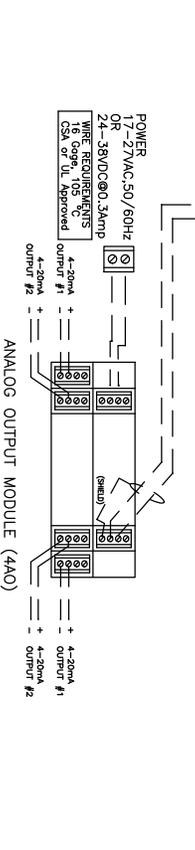
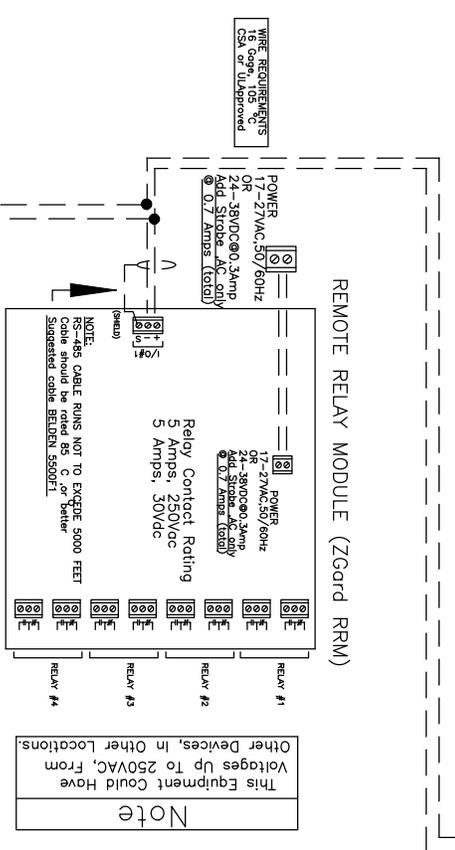


NOTE: MULTIPLE 24VAC TRANSFORMERS SHOULD BE USED SO POWER WIRE CAN BE 16 GAUGE (9 AMPS MAX) BELDEN # 8471 IS ACCEPTABLE

FOR DASTY-CHAIN (SERIES) WIRING OF ZGARD S SENSORS TO THE ZGARD CX II AS SHOWN HERE, EACH SENSOR MUST BE UNIQUELY ADDRESSED VIA SWITCHES ON SENSOR CIRCUIT BOARD.

ZGard CXII CONTROLLER

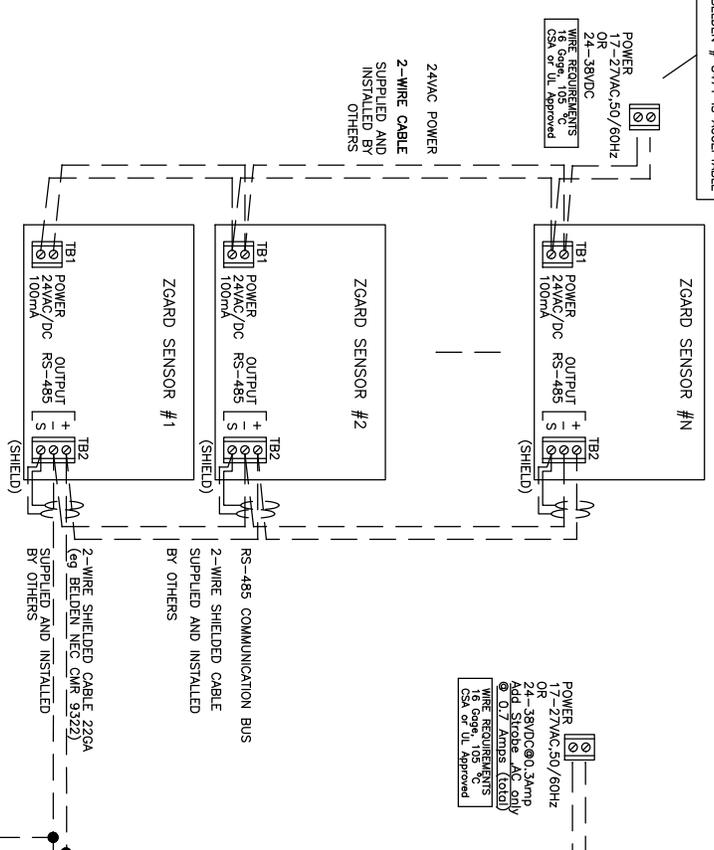

**NOTES:**  
 1. DIMENSIONS SHOWN IN INCHES (MILLIMETERS).  
 2. SYSTEM MAY CHANGE TO IMPROVE PERFORMANCE.

**REVD** Cautions Removed  
**REV.C** PowerLabels/Relay Rating  
**REV.B** Sensor Wiring Changed + ZRM  
**MSA**

CHKD: V.B DATE: Jun. 26/08 DRN: D.P  
 ZGARD CX II  
 Programmable Controller  
 Installation Outline  
 DWG. NO.: 107389-1 REV. D